




BACKWALL/BINWALL INTERSECTION — 4/4

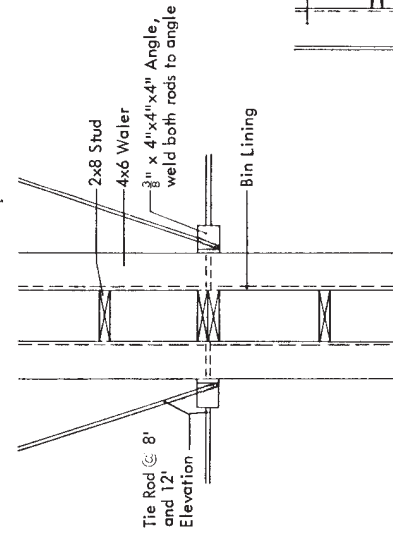


INTERIOR BINWALL DETAIL — 5/4

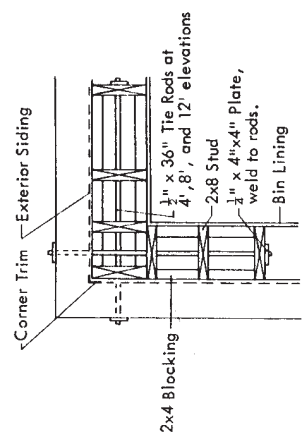


CORNER DETAIL — 1/4

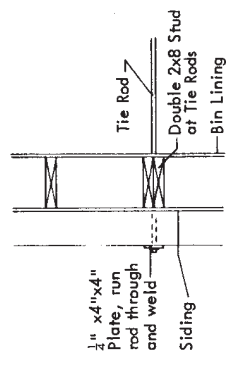


ENDWALL TIE ROD DETAIL — 2/4

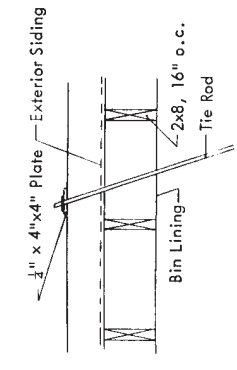

BACKWALL TIE ROD DETAIL — 3/4

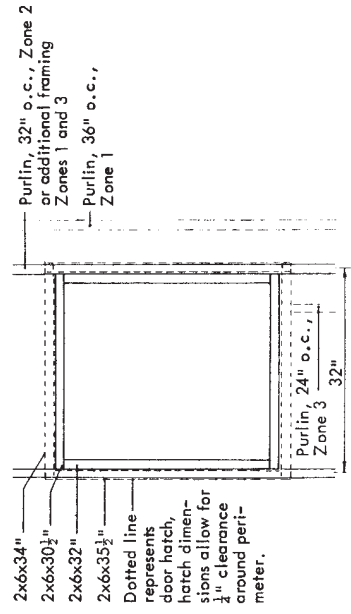

ROOF HATCH DETAIL — 6/4

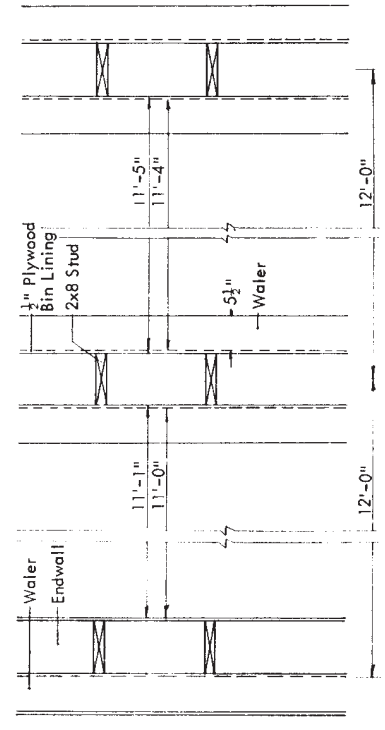

BIN CLEARANCE DETAIL — 7/4

TRUSSES

July, 1984

Dear Customer:

When this plan was released, the last sheet had details for glue-nailed truss selection. Most buildings are erected with purchased trusses. The truss sheet did not have space enough to present all that was needed to build glue-nailed trusses.

Therefore, the sheet has been dropped. The plan has not yet been revised to include the following notes:

TRUSS NOTES

If you buy trusses:

Specify the span, slope, and spacing shown on the plan. Specify the roof and ceiling types. Require strength adequate for the wind and snow loads for your locality.

Require installation details specifying anchorage, bracing, and roofing and ceiling framing and attachment. If you buy glue-nailed trusses:

Have them built and installed to the recommendations in MWPS-9, *Designs for Glued Trusses*, Fourth Edition.

If you build your own trusses:



Get a copy of MWPS-9 and follow its recommendations.

Send \$5.00 for *Designs for Glued Trusses, MWPS-9* to:

Midwest Plan Service, 122 Davidson Hall, Iowa State University, Ames, IA 50011

Windbracing

Brace and anchor the trusses as they are placed. Bottom chord stiffeners are required at panel points unless a rigid ceiling is to be installed. Use king post crossbracing in all buildings.

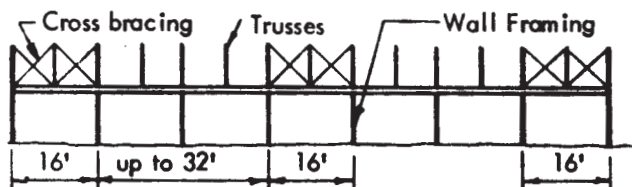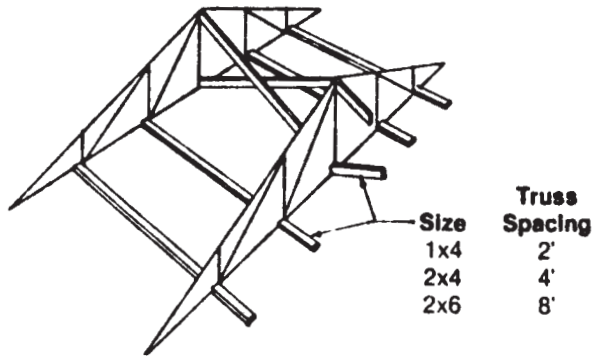

Wind Anchorage

Minimum fasteners for wind anchorage, both ends of each truss.

Truss span	Truss spacing		
	2'	4'	8'
20'-24'	1A or 1B	1A or 1B	2A or 1B
26'-30'	1A or 1B	1A or 1B	2A or 2B
32'-46'	1A or 1B	2A or 1B	3A or 2B
48'-50'	1A or 1B	2A or 1B	4A or 2B
52'-60'	1A or 1B	2A or 2B	4A or 3B

A - metal framing anchor


4-30d ring-shank nails = 1/2" bolt

B - 1/2" bolt

Roof Purlins


Stagger purlin joints for continuity across the trusses. Purlins may be laid flat with 2' and 4' truss spacings and butt joints used.

Alternating purlin lengths may be used in pole buildings where the poles are spaced evenly and the trusses are not. For poles 8' o.c. they may be of alternating 16' and 18' lengths with staggered and lapped end joints if pairs of trusses are mounted on alternate sides of the poles.

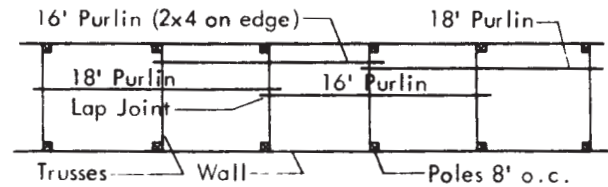

Overhang

For a 2' to 4' overhang, use the top chord and heel gusset design for a 1/3 larger snow load.

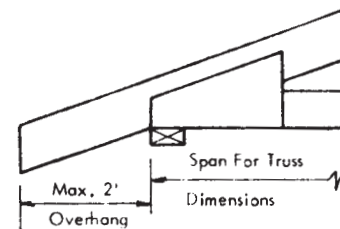

Loads

Install trusses to withstand the loads.

- Required by any applicable building code.
- Recommended by an engineer familiar with farm buildings in your area.
- Or, if necessary, estimated from the material below.

Ceiling Dead Load

- 0 psf allows for no materials in addition to the truss, bracing, and stiffeners.
- 5 psf ceiling dead load allows for a metal or plywood ceiling with insulation (warm livestock buildings).
- 8 psf ceiling dead load allows for a gypsum board ceiling with insulation (residential or light commercial buildings).

Roof Dead Load

Add the weights of the truss, purlins or decking, roofing, and roof insulation to get the dead load on the top chord.

Approximate weights of trusses, psf

Example: a 4-web truss for 4' spacing with 2x8 top chord and 2x6 bottom chord weighs about 1.3 + 0.7 = 2.0 psf. Dashed lines in table indicate example.

Chord size Top	Bottom	Truss spacing		
		2'	4'	8'
2x4	2x4	1.6	0.8	0.4
2x6	2x4	2.0	1.0	0.5
2x6	2x6	2.4	1.2	0.6
2x8	2x6	2.7	1.3	0.7
2x10	2x4 + 2x4	3.3	1.6	0.8
2x12	2x4 + 2x6	4.0	2.0	1.0
2x12	2x6 + 2x6	4.4	2.2	1.1

Add the following for:

2-&4-Web Truss	1.4	0.7	0.4
6 Web Truss	2.1	1.2	0.6

Recommended snow loads

For roofs up to about 1/2 slope for buildings outside the jurisdiction of a building code. Farm buildings:

50-yr map load x 0.9 for 25-yr x 0.8 for snow on roof.
Other buildings: 50-yr map load x 0.8 to convert from snow on ground to snow on roof.

Minimum recommended load is 12 psf. In areas where all of the maximum snow load results from a single storm without significant wind, the maximum roof load may equal the ground snow load.


Map load	Roof snow load	
	Farm	Other
15	12.0	12
20	14.4	16
30	21.6	24
40	28.8	32
50	36.0	40
60	43.2	48
70	50.4	56
80	57.6	64
90	64.8	72
100	72.0	80
110	79.2	88
120	86.4	96

Weights of roofing and ceiling materials

2x4s, 2' o.c.	0.7 psf
2x6s, 2' o.c.	1.1
1" lumber, solid	2.2 psf
1x3s, 16" o.c.	0.4
3/8" plywood	1.1
1/2" plywood	1.4
0.024" aluminum	0.4
28 ga steel	0.9
Asphalt shingles	2.6
Insulation, per inch of thickness	0.1-0.4

Wind Loads

For most areas of the U.S., trusses are designed to withstand winds of 80 mph on a building less than 30' high.

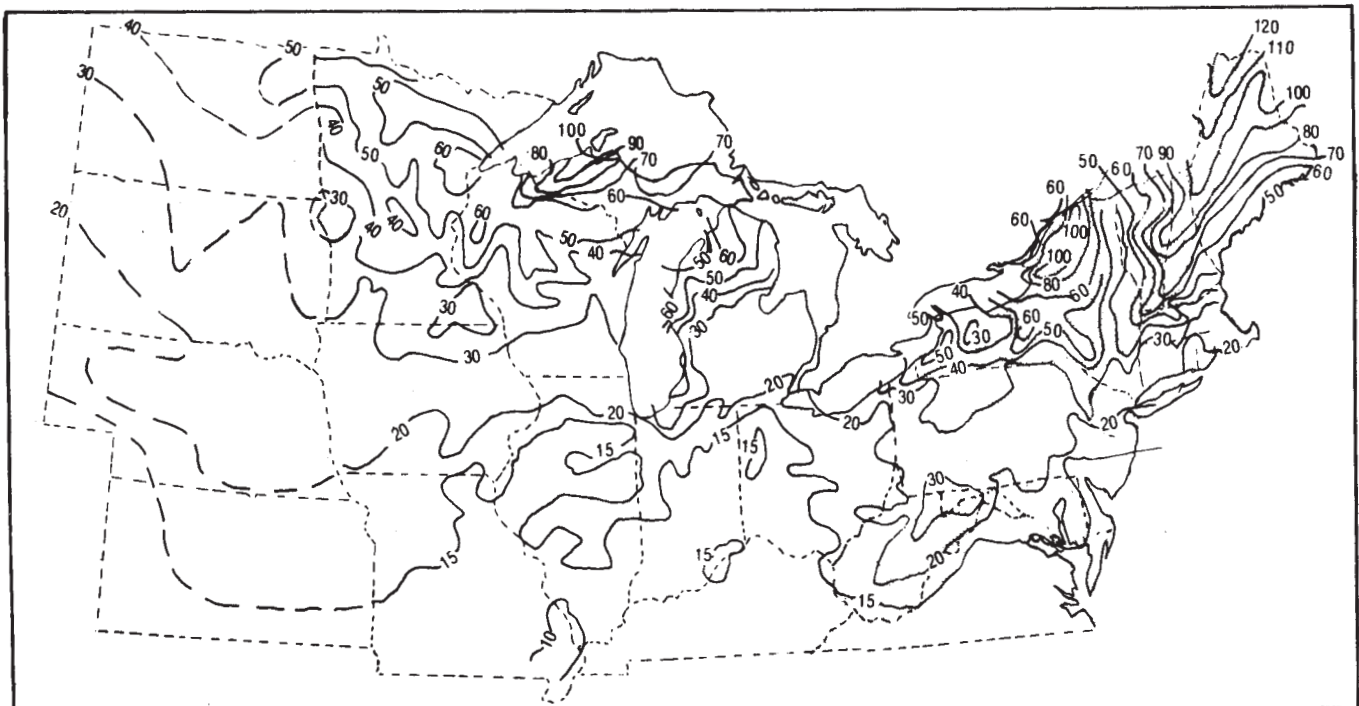

Snow load on the ground, 50-yr recurrence interval